

Appendix 11

Measurement of sound absorption coefficient

Test Measurement of sound absorption coefficient in a reverberation room according to SS-EN 20354 (ISO 354).

Client Saint-Gobain Ecophon AB

Object Christer Persson


Object Lithos A
Thickness: 22 mm.
Panel size: 1000 mm x 1500 mm.

Date of test March 24, 2005

Conditions Mounting depth: 200 mm.
Surface area: 10,8 m².
Room volume: 200 m³.
Temperature at measurement on object/in empty room: 20/ 20 °C.
Relative humidity at measurement on object/in empty room: 87/ 85 %.

Result Sound absorption class B according to EN ISO 11654.
Weighted sound absorption coefficient $\alpha_w = 0,85$ according to EN ISO 11654.

Sound absorption coefficient

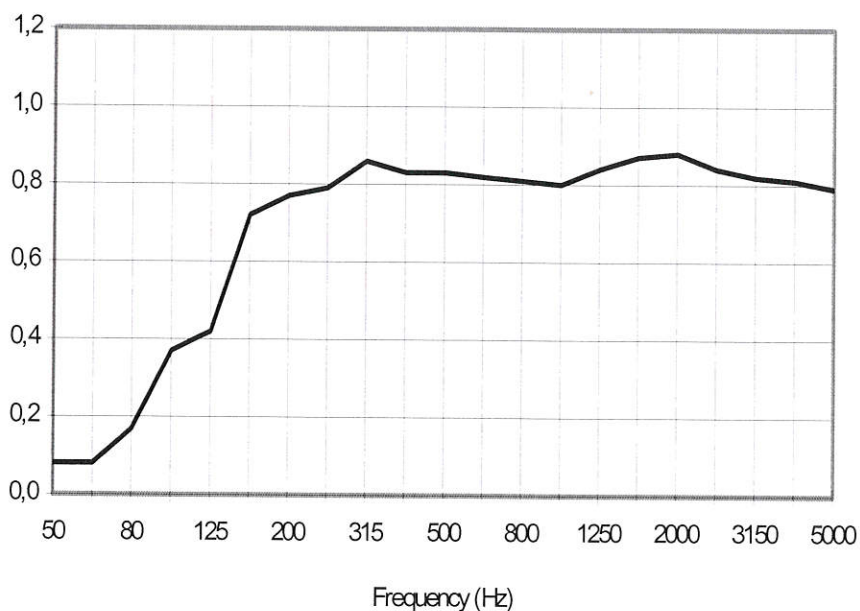


Frequency (Hz)	α_s
50	0,08
63	0,08
80	0,17
100	0,37
125	0,42
160	0,72
200	0,77
250	0,79
315	0,86
400	0,83
500	0,83
630	0,82
800	0,81
1000	0,80
1250	0,84
1600	0,87
2000	0,88
2500	0,84
3150	0,82
4000	0,81
5000	0,79

Measurement of sound absorption coefficient

Test Measurement of sound absorption coefficient in a reverberation room according to SS-EN 20354 (ISO 354).
Client Saint-Gobain Ecophon AB
Object Christer Persson
 Lithos A
 Thickness: 22 mm.
 Panel size: 1000 mm x 1500 mm.
Date of test March 24, 2005
Conditions Mounting depth: 200 mm.
 Surface area: 10,8 m².
 Room volume: 200 m³.
 Temperature at measurement on object/in empty room: 20/ 20 °C.
 Relative humidity at measurement on object/in empty room: 87/ 85 %.
Result Sound absorption class B according to EN ISO 11654.
 Weighted sound absorption coefficient $\alpha_w = 0,85$ according to EN ISO 11654.

Practical sound absorption coefficient

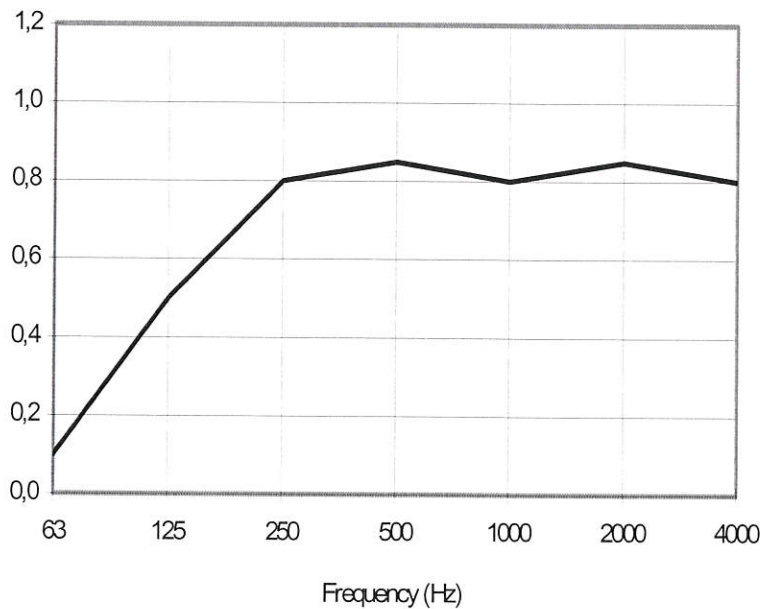

Frequency (Hz)	α_p
63	0,10
125	0,50
250	0,80
500	0,85
1000	0,80
2000	0,85
4000	0,80