

Confidential

[See SRL report C/23574/T01 for full details](#)

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

**Client:** fade® Acoustic Ceilings

**Test Date:** 11/11/2016

**Empty Room:** **Temperature:** 15.3 °C **Humidity:** 52 %RH **Pressure:** 1013 mbar

**Room with Sample:** **Temperature:** 15.4 °C **Humidity:** 52 %RH **Pressure:** 1013 mbar


**Sample Description:** 25mm fade® Acoustic Plaster - PLUS+

**Mounting Method:** A

**Sample Area:** 13.18 m<sup>2</sup>

**Chamber Volume:** 300 m<sup>3</sup>

Test 2				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	4.12	4.02	0.02	
63*	4.42	4.34	0.02	n/a
80*	5.66	5.21	0.06	
100	6.42	6.04	0.04	
125	6.85	5.33	0.15	0.15
160	6.63	4.55	0.25	
200	6.72	3.63	0.47	
250	7.09	3.05	0.69	0.60
315	7.13	3.23	0.63	
400	6.44	3.06	0.63	
500	5.68	2.91	0.62	0.70
630	5.28	2.49	0.78	
800	5.64	2.16	1.06	
1000	6.04	2.48	0.88	1.00
1250	5.71	2.25	1.00	
1600	5.20	2.26	0.93	
2000	4.67	2.16	0.92	0.90
2500	4.10	2.11	0.85	
3150	3.38	1.89	0.86	
4000	2.65	1.70	0.78	0.80
5000	2.11	1.48	0.75	
6300*	1.42	1.11	0.73	
8000*	1.13	0.93	0.71	n/a
10000*	0.81	0.70	0.73	

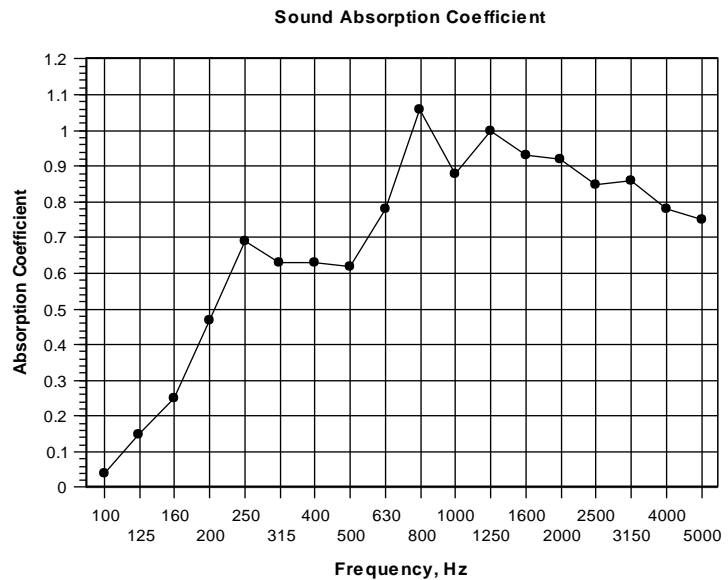

$\alpha_w$  0.80

**Class B**

Calculated to EN ISO 11654:1997

**NRC 0.80**

Calculated to ASTM C 423-01

\* Denotes frequencies outside the range covered by BS EN ISO 354:2003

T1, empty room reverberation time  
T2, room reverberation time with sample

# Practical absorption coefficient, BS EN ISO 11654:1997

v4.3



**Richard Calvert**

Approved Signatory



**Richard Critchlow**

Deputy Technical Manager

This certificate shall not be reproduced, except in full, without written approval of the laboratory